
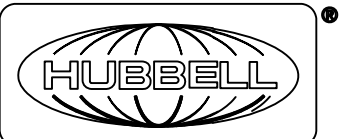


ATD-, ATU-, ATP-  
Series Sensors

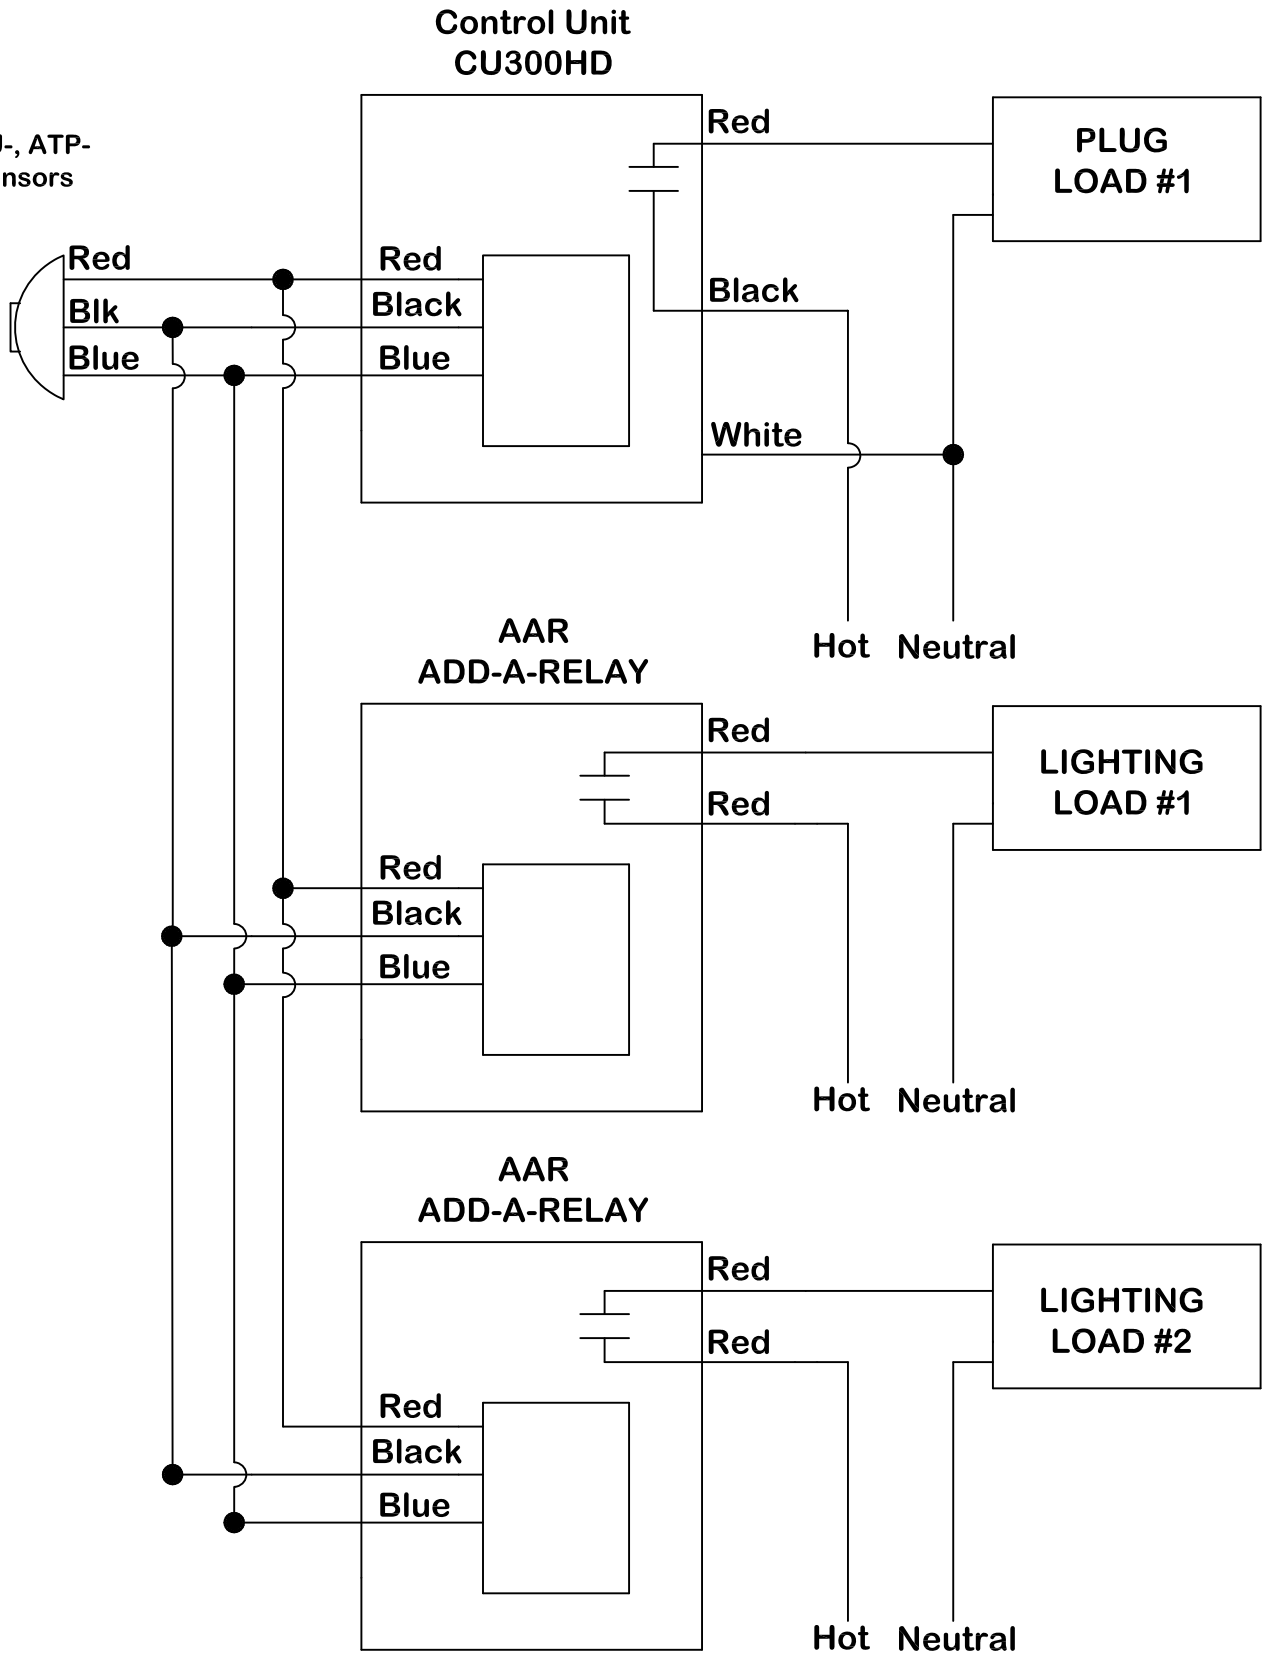



Wiring Device-Kellems

**HUBBELL INC.**  
Wiring Device-Kellems  
40 Waterview Drive  
Shelton, CT 06484  
Tel: (475) 882-4820  
Fax: (203) 882-4852

1 Sensor, 1 HD Control Unit, & 2 AAR

Form Number:  
1S1CUHD2AAR

Date:  
09/02/2014 SS

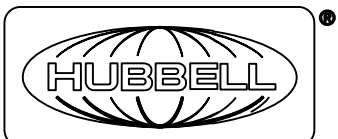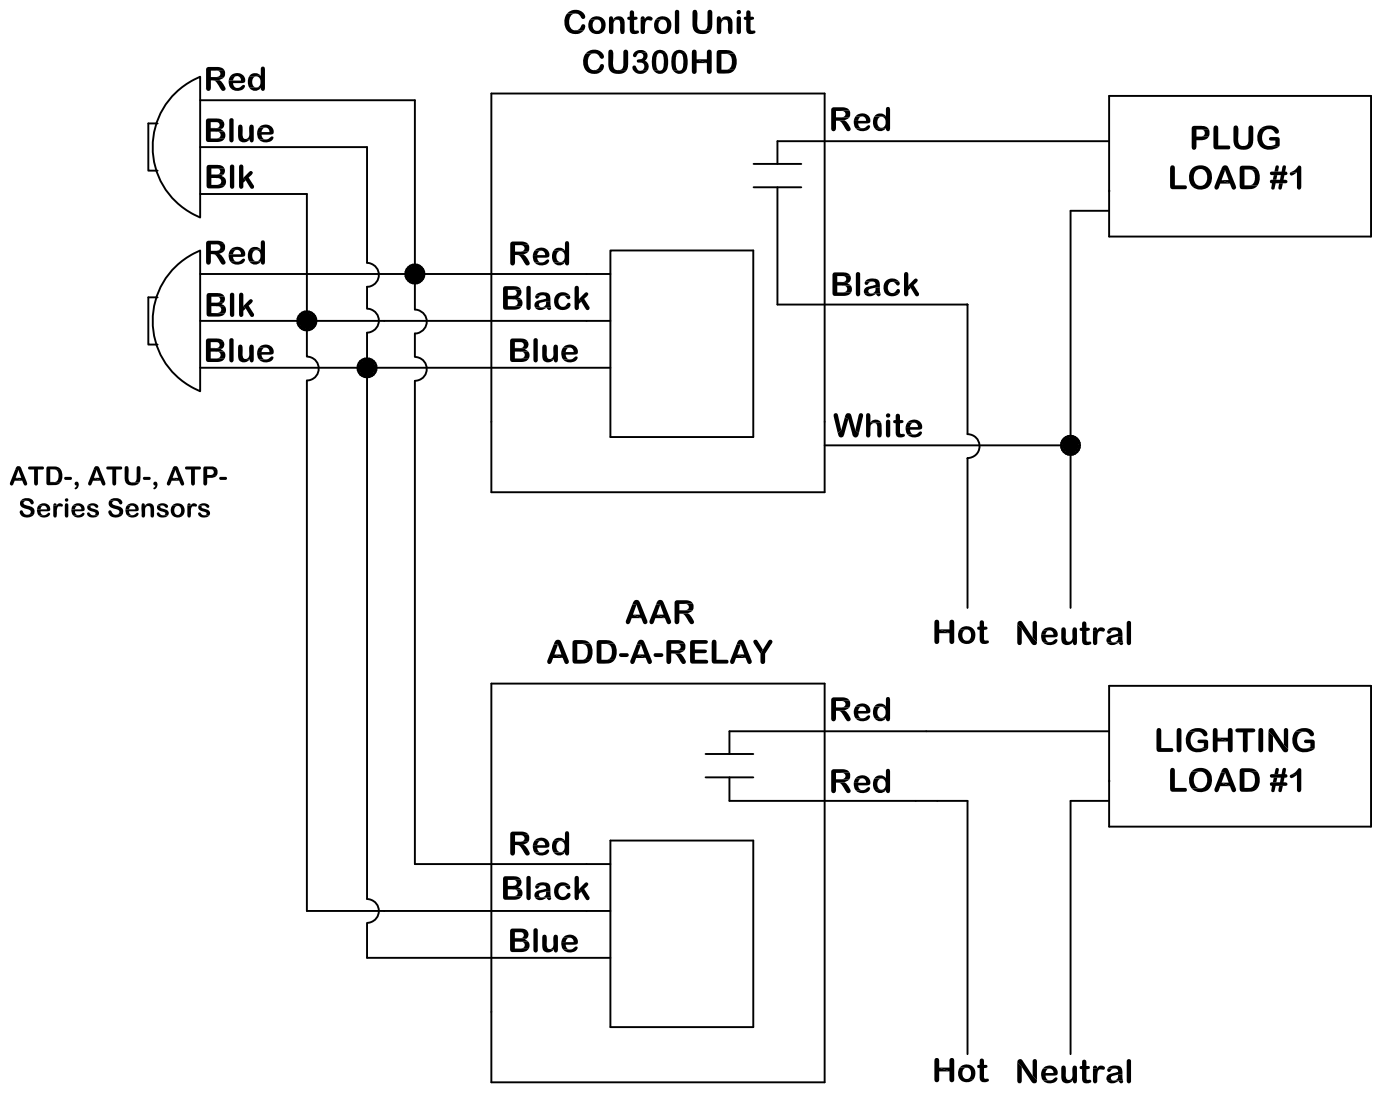

Wiring Device-Kellems


**HUBBELL INC.**  
 Wiring Device-Kellems  
 40 Waterview Drive  
 Shelton, CT 06484  
 Tel: (475) 882-4820  
 Fax: (203) 882-4852

2 Sensors, 1 HD Control Unit, & 1 AAR

Form Number:  
2S1CUHD1AAR


Date:  
09/02/2014 SS

**Control Unit  
CU300HD**


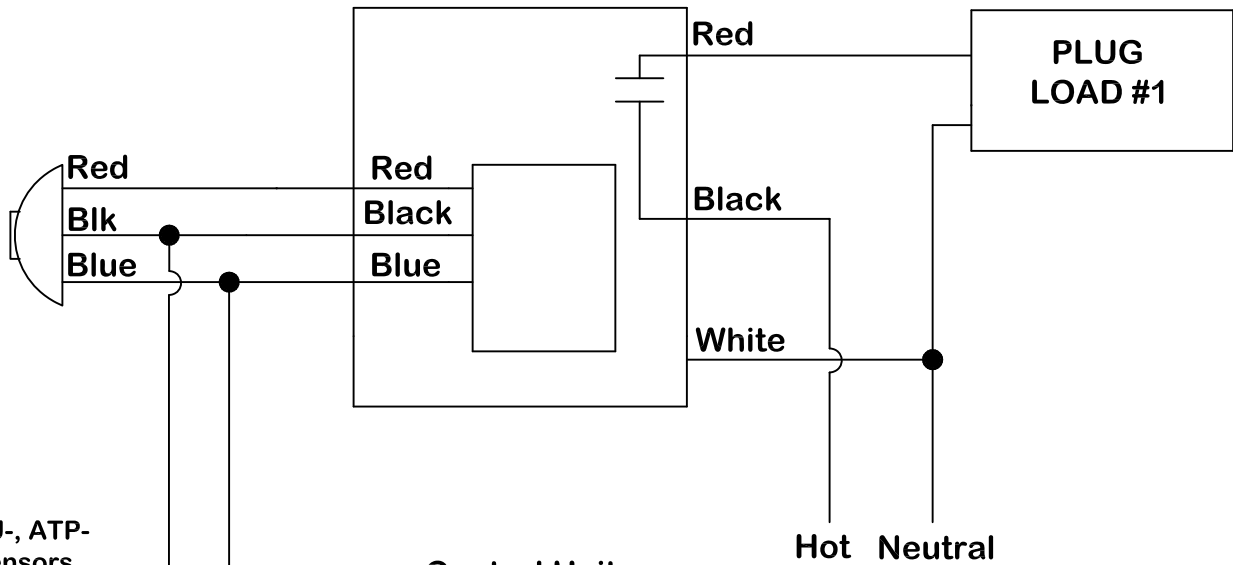


ATD-, ATU-, ATP-  
Series Sensors

**Control Unit  
CU300HD**

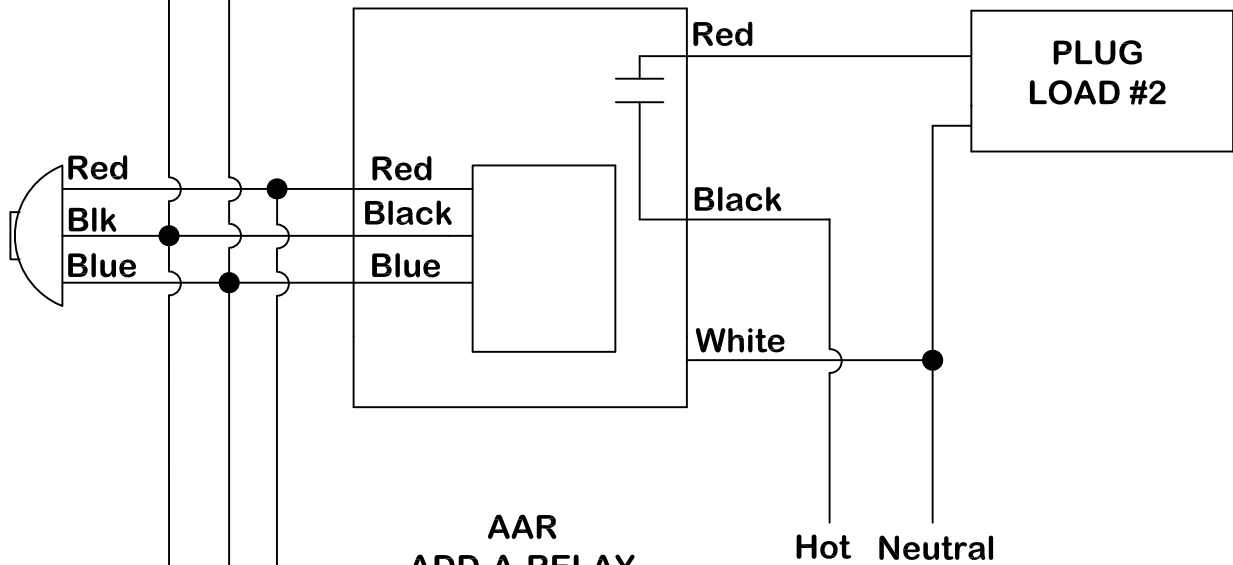

**AAR  
ADD-A-RELAY**

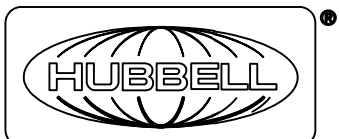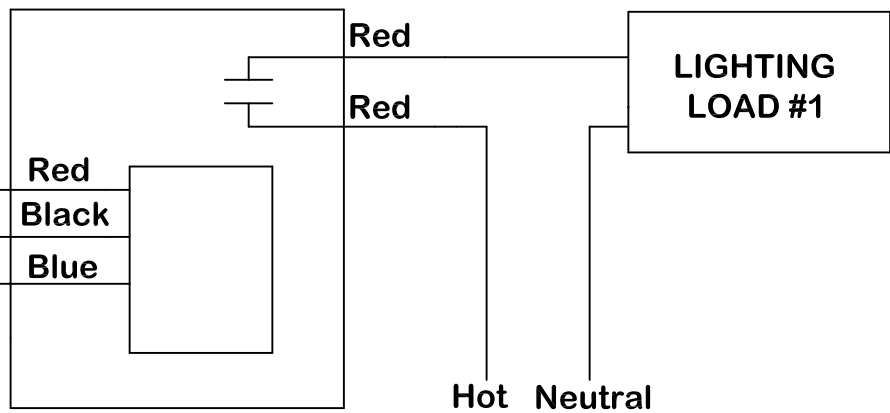


Wiring Device-Kellems

**HUBBELL INC.**  
Wiring Device-Kellems  
40 Waterview Drive  
Shelton, CT 06484  
Tel: (475) 882-4820  
Fax: (203) 882-4852

2 Sensors, 2 HD Control Units, & 1 AAR

Form Number:  
2S2CUHD1AAR

Date:  
09/02/2014 SS

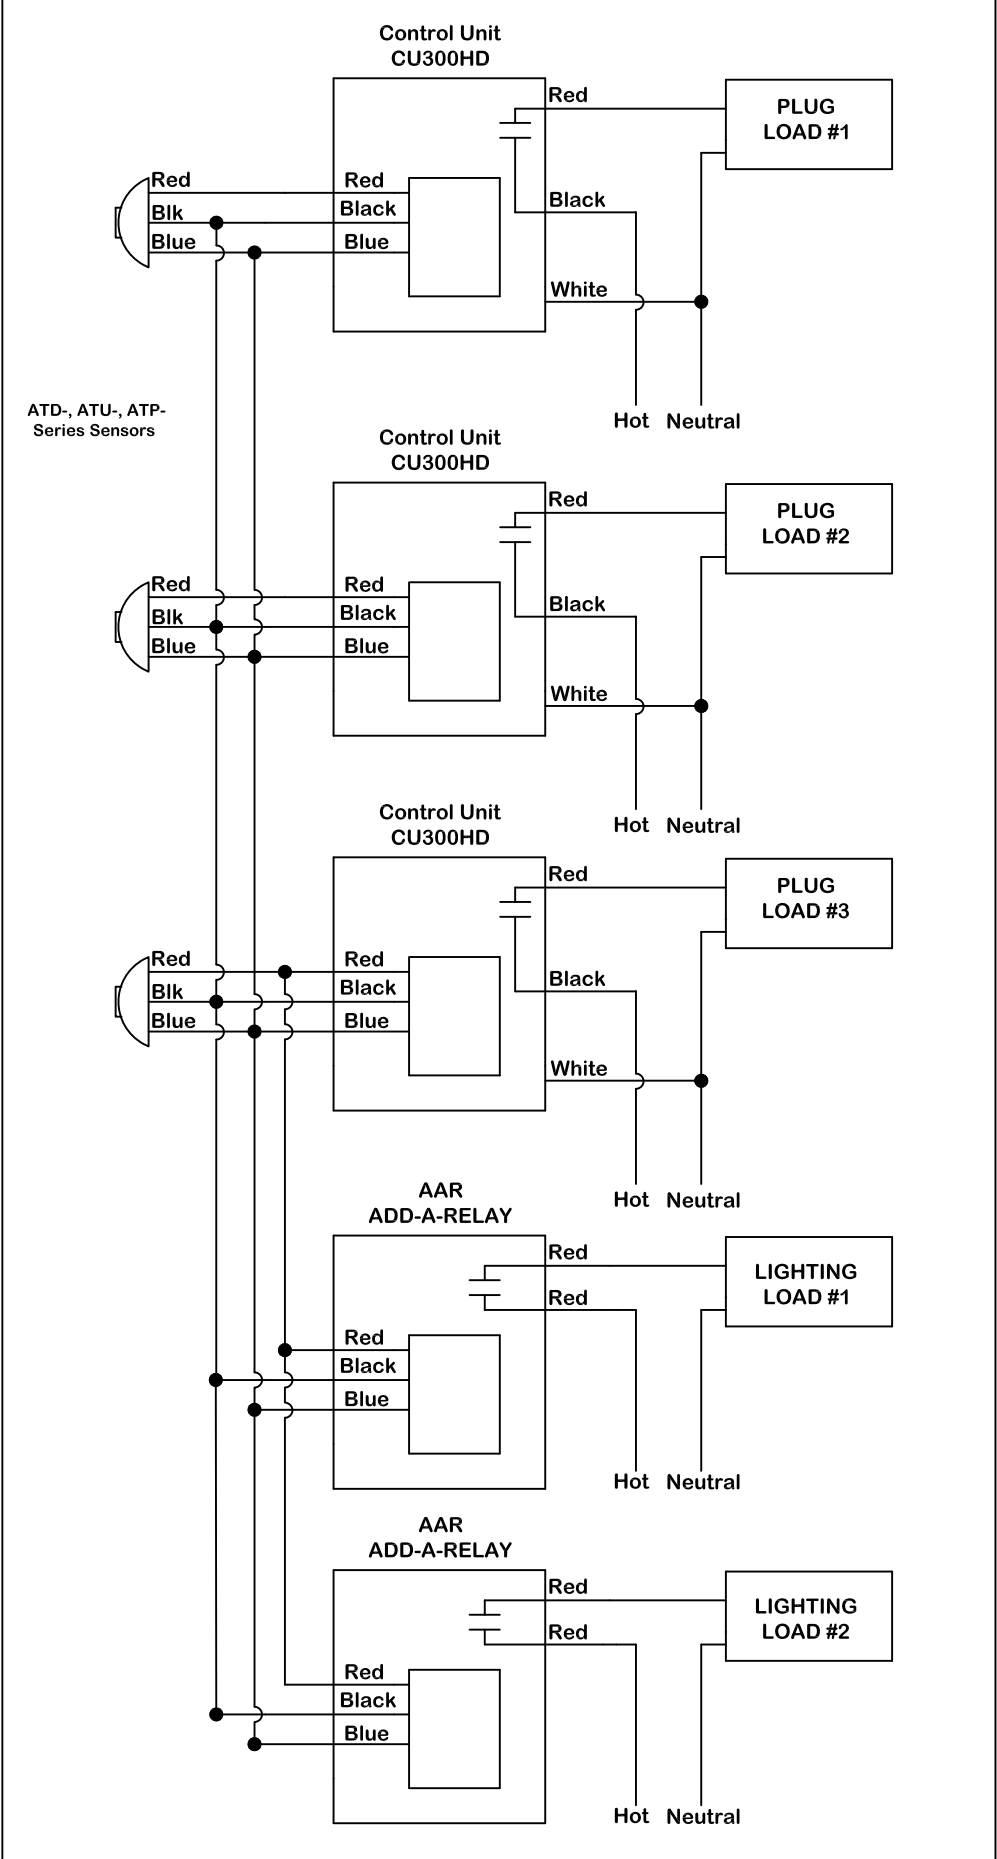

ATD-, ATU-, ATP-  
Series Sensors




**HUBBELL INC.**  
 Wiring Device-Kellems  
 40 Waterview Drive  
 Shelton, CT 06484  
 Tel: (475) 882-4820  
 Fax: (203) 882-4852

3 Sensors, 3 HD Control Units, & 2 AAR

Form Number:  
3S3CUHD2AAR

Date:  
09/02/2014 SS


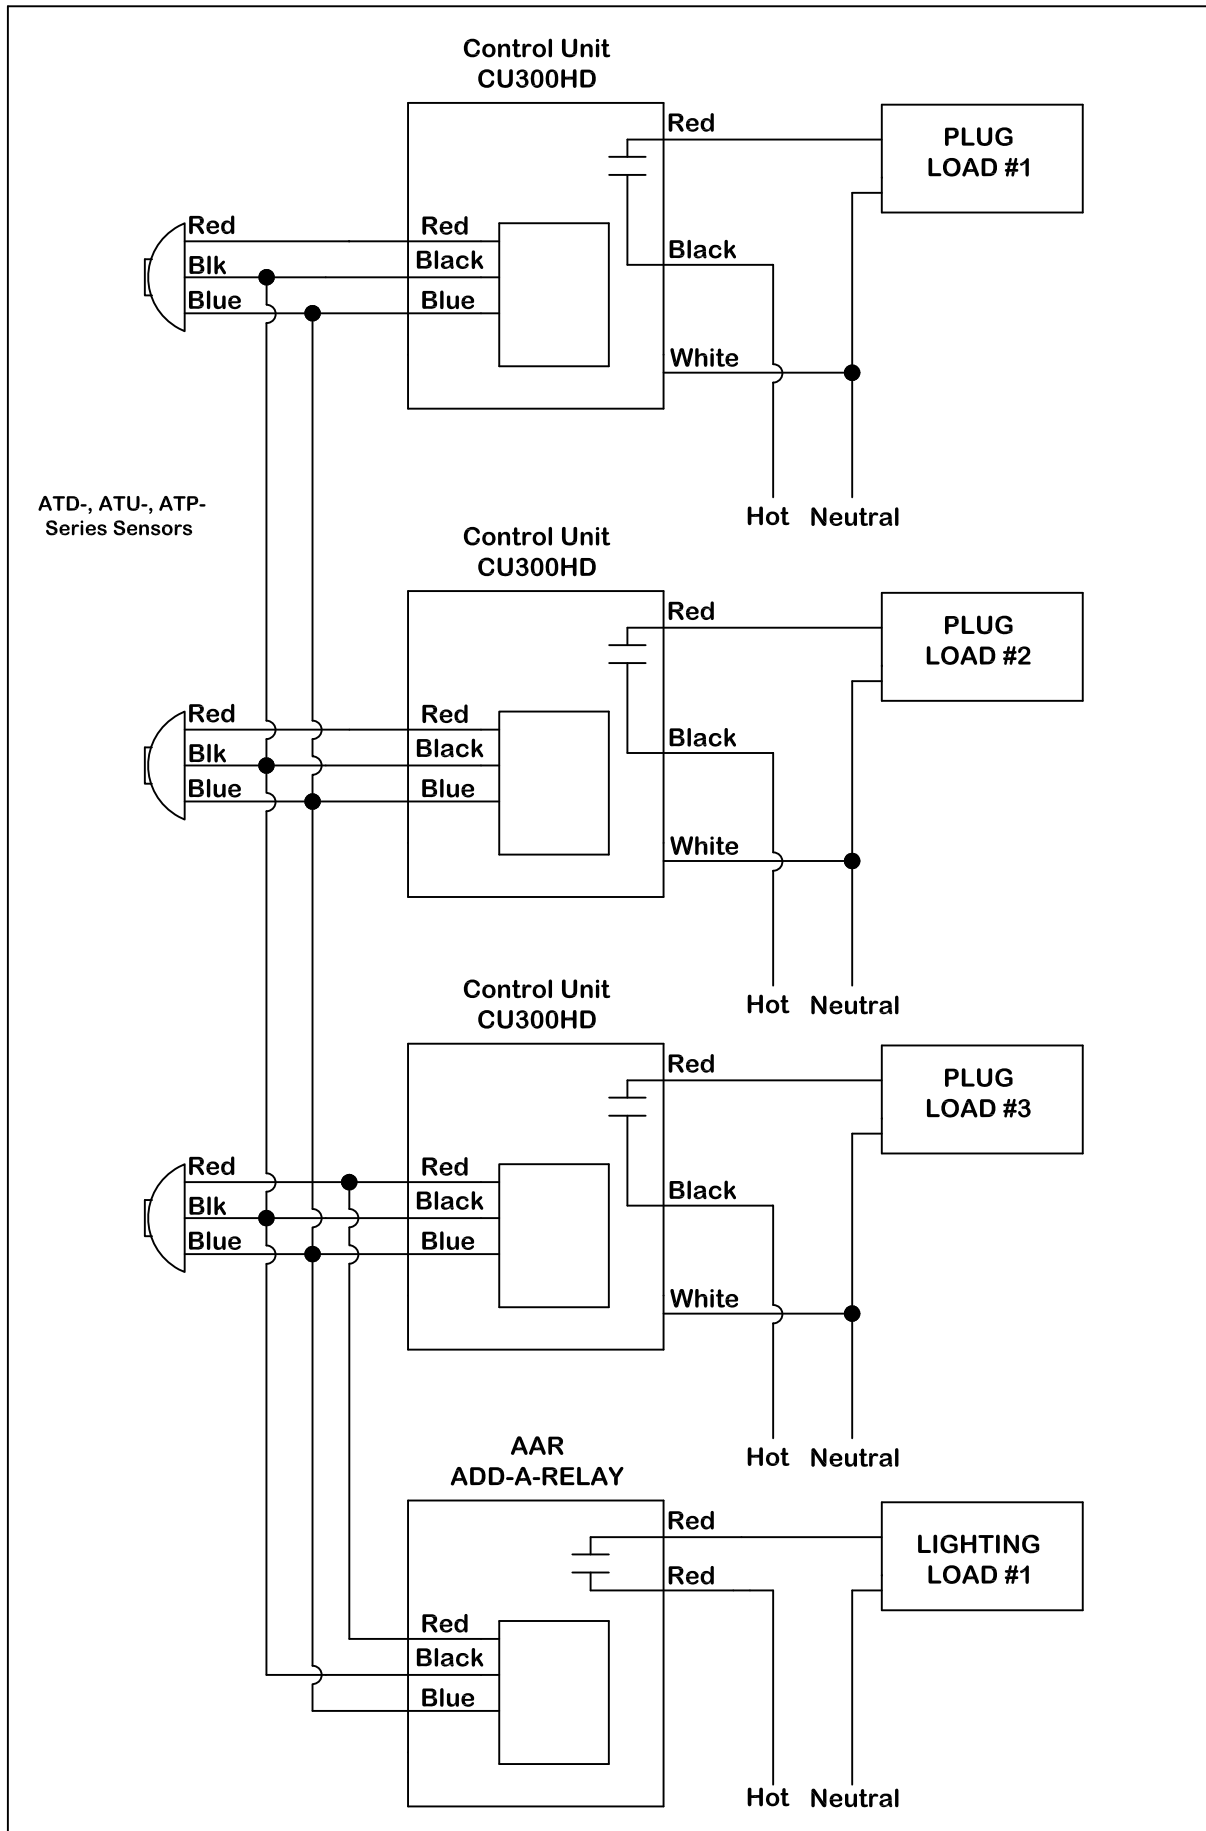


**HUBBELL INC.**  
 Wiring Device-Kellems  
 40 Waterview Drive  
 Shelton, CT 06484  
 Tel: (475) 882-4820  
 Fax: (203) 882-4852

3 Sensors, 3 HD Control Units, & 1 AAR

Form Number:  
 3S3CUHD1AAR

Date:  
 09/02/2014 SS

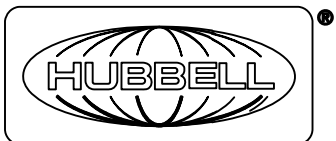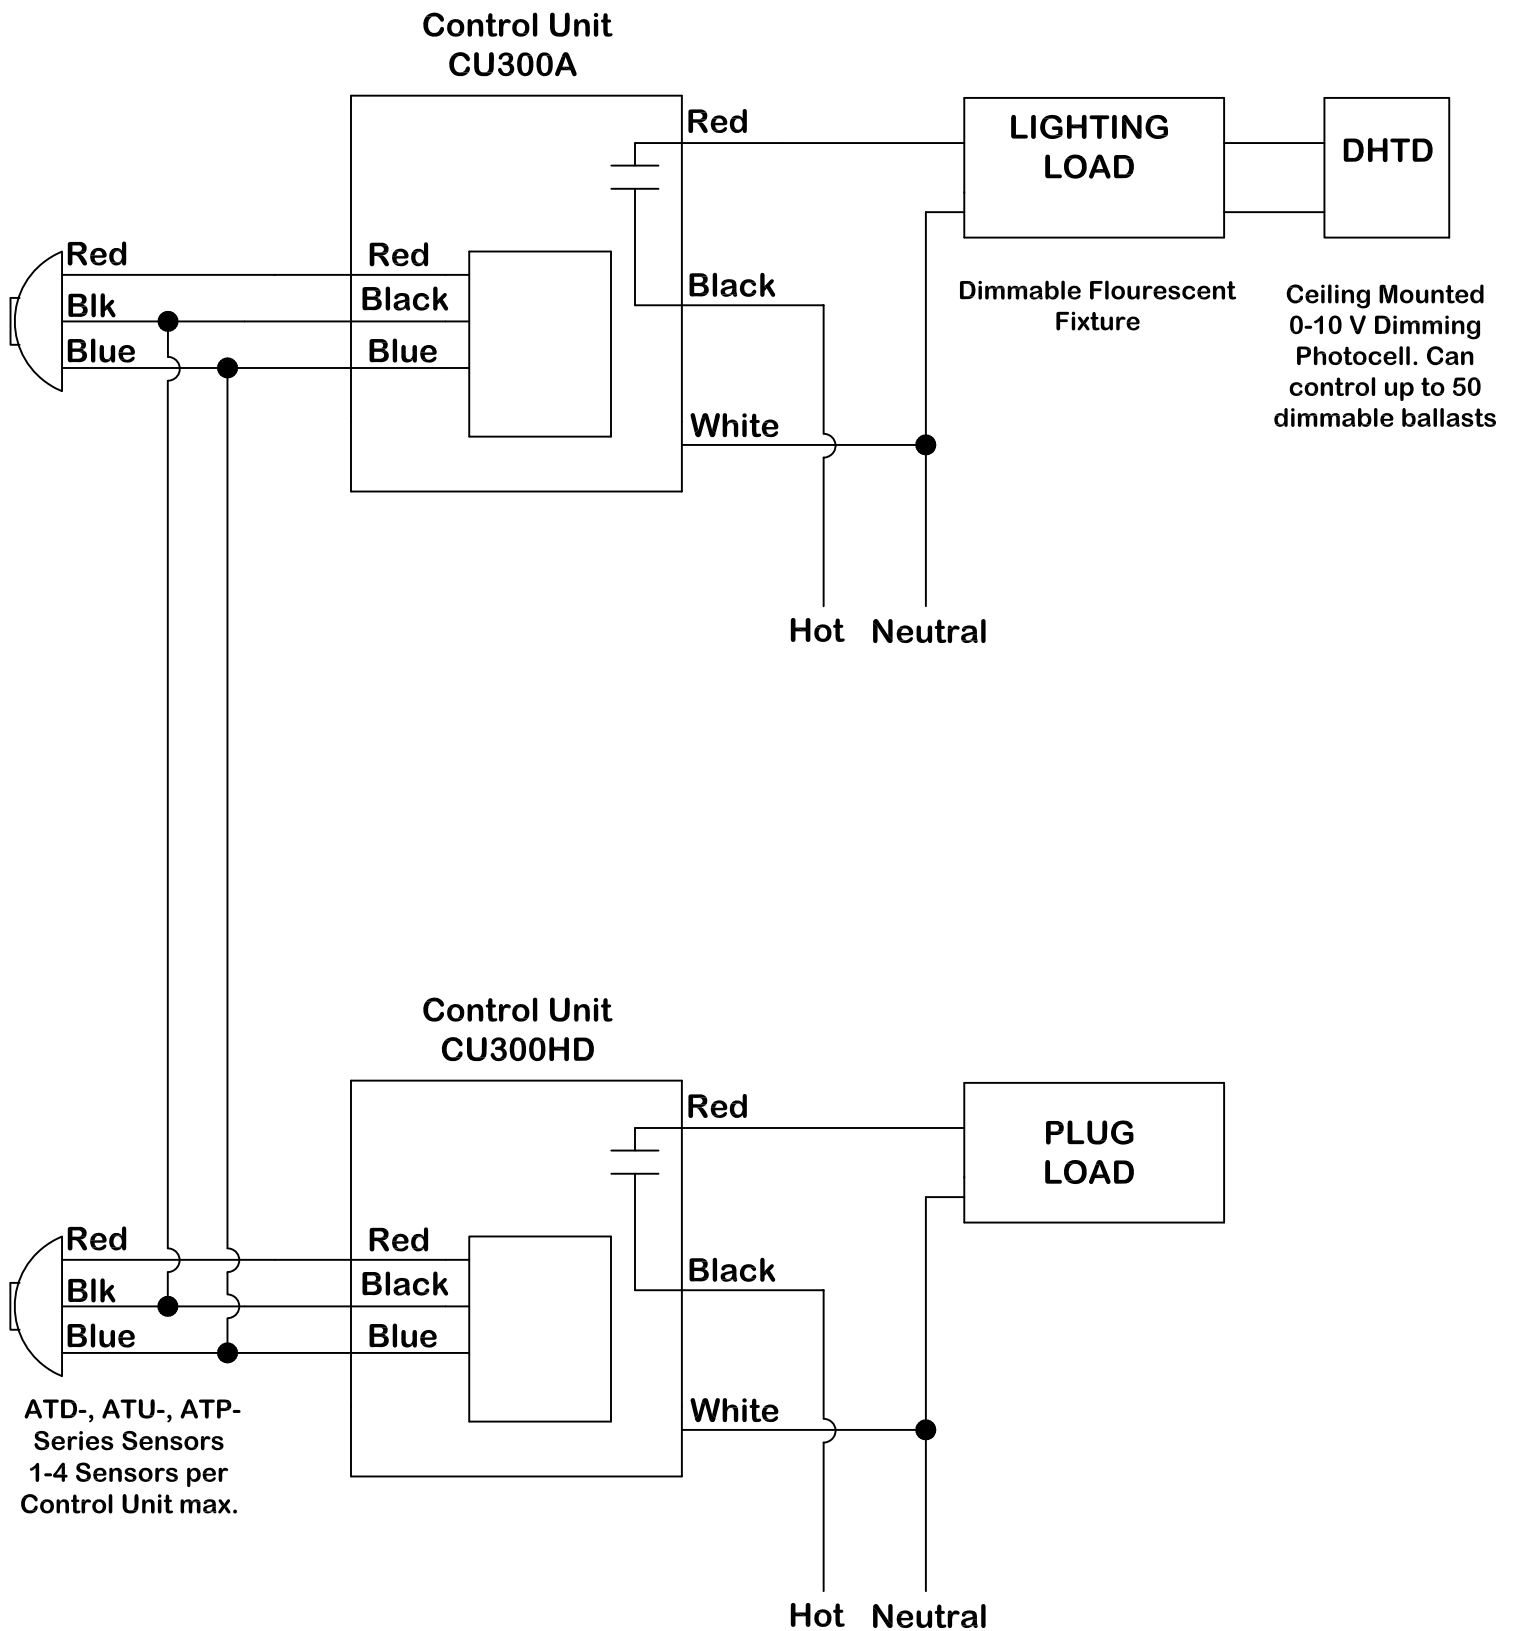



Wiring Device-Kellems

**HUBBELL INC.**  
 Wiring Device-Kellems  
 40 Waterview Drive  
 Shelton, CT 06484  
 Tel: (475) 882-4820  
 Fax: (203) 882-4852

2 Sensors, 1 CU300A, 1 CU300HD, &  
 DHTD

Form Number:  
 2S1CUA1CUHDDHTD

Date:  
 10/09/2014 SS

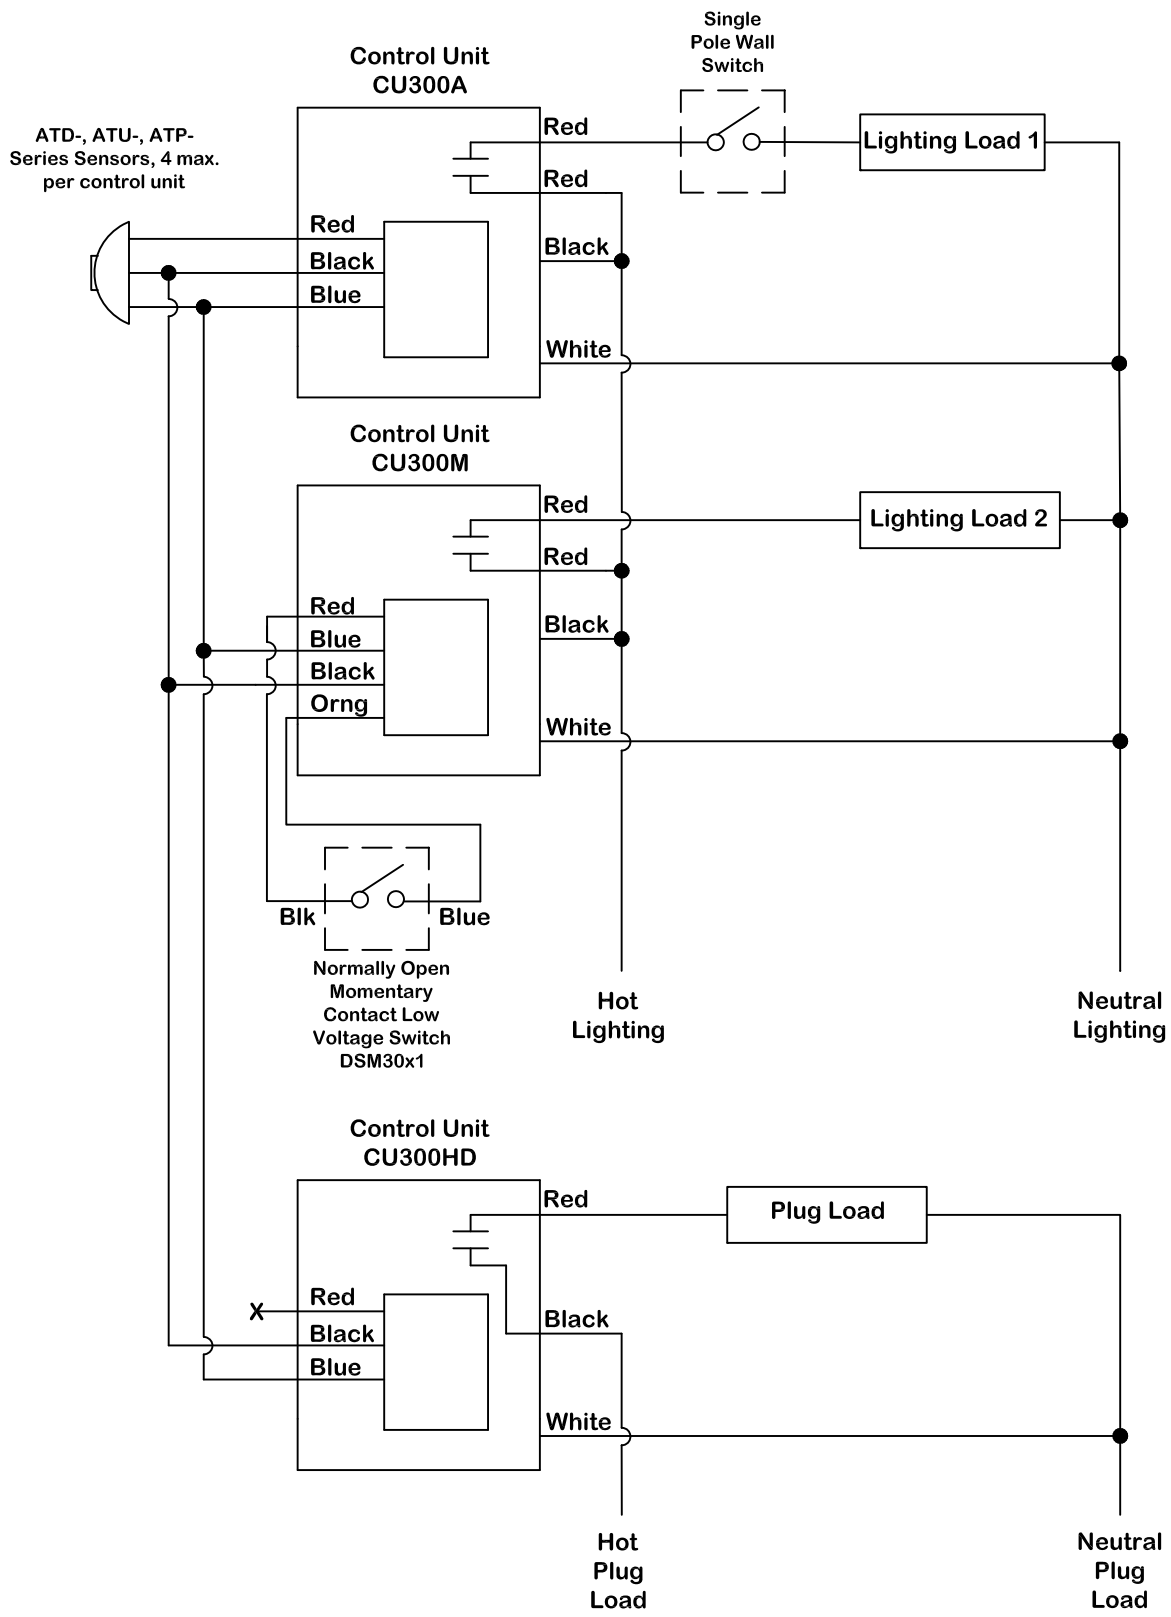



Wiring Device-Kellems

**HUBBELL INC.**  
 Wiring Device-Kellems  
 40 Waterview Drive  
 Shelton, CT 06484  
 Tel: (475) 882-4820  
 Fax: (203) 882-4852

1 Sensor 1 Occupancy Control unit with Override Switch  
 1 Vacancy Control Unit with Low Voltage Momentary Switch 1  
 Heavy Duty Control Unit for Plug Load

Form Number:  
 1S1CUA0OS1CUMLVMS1CUHD

Date:  
 12/16/2014 SS

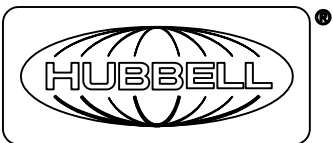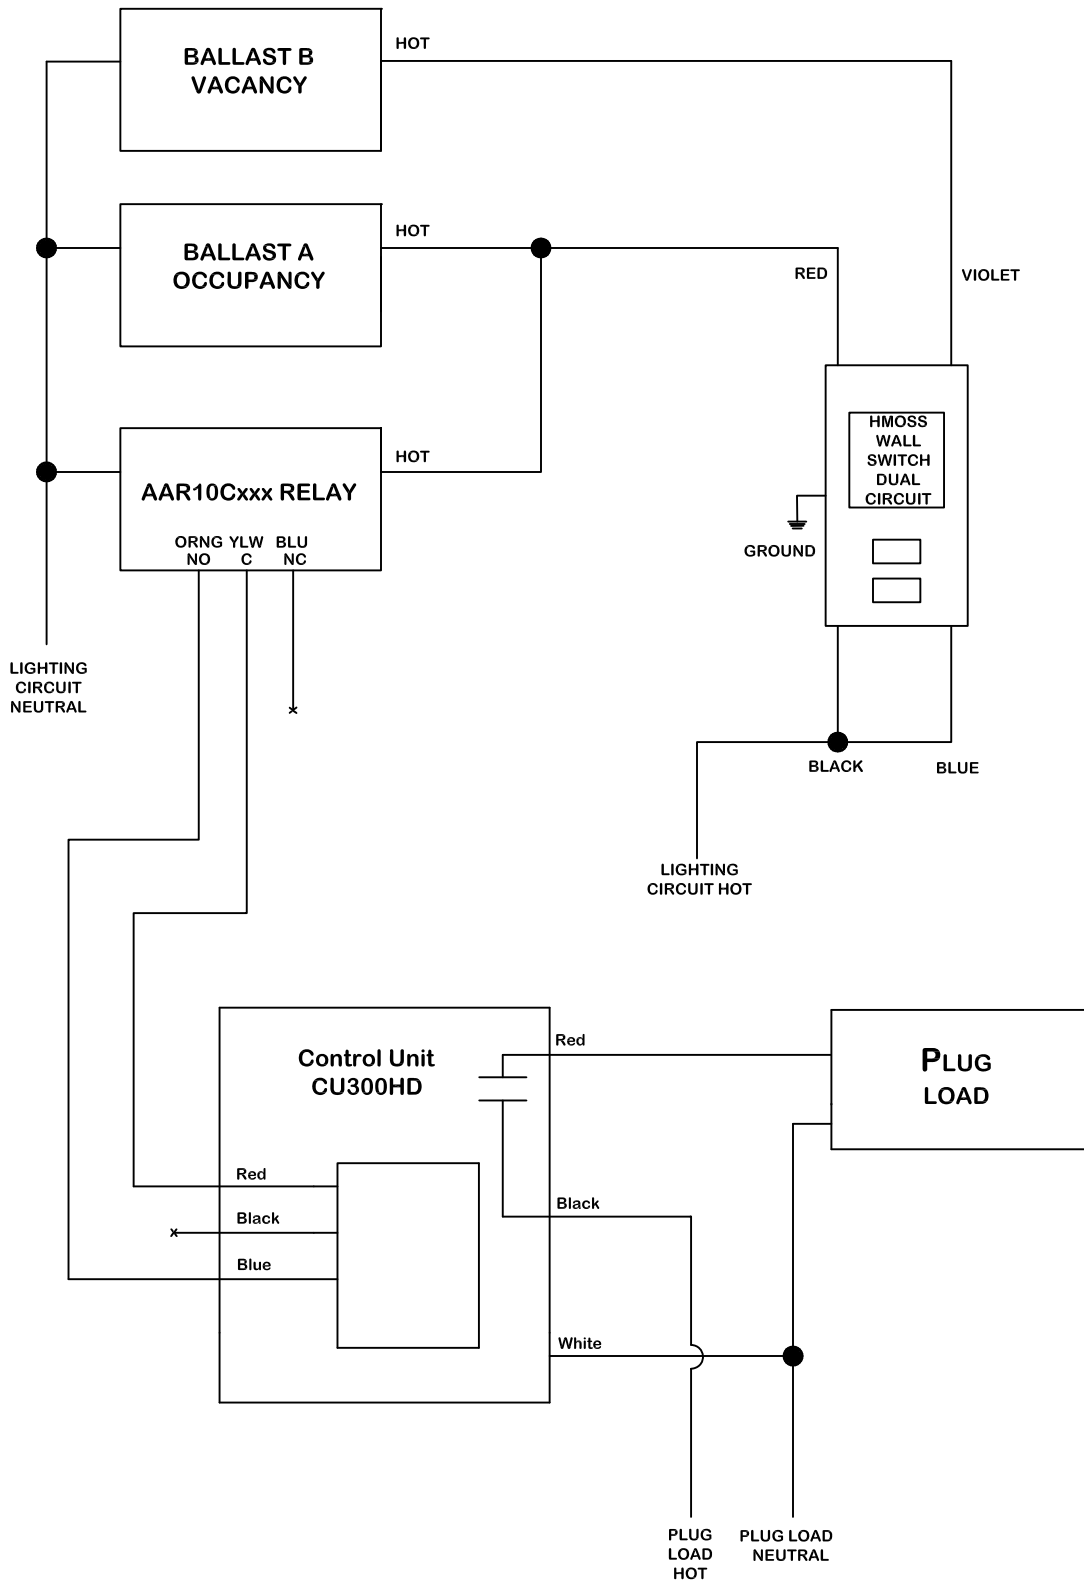

Wiring Systems

**HUBBELL INC.**  
 Wiring Systems  
 40 Waterview Drive  
 Shelton, CT 06484  
 Tel: (475) 882-4820  
 Fax: (203) 882-4852

**2 Circuit Wall Switch, AAR10CXXX  
 & CU300HD**

Form  
 Number:

DWSSAAR10CXXXCUHD

Date: 09-24-2014 SS